




# Lower wiring costs



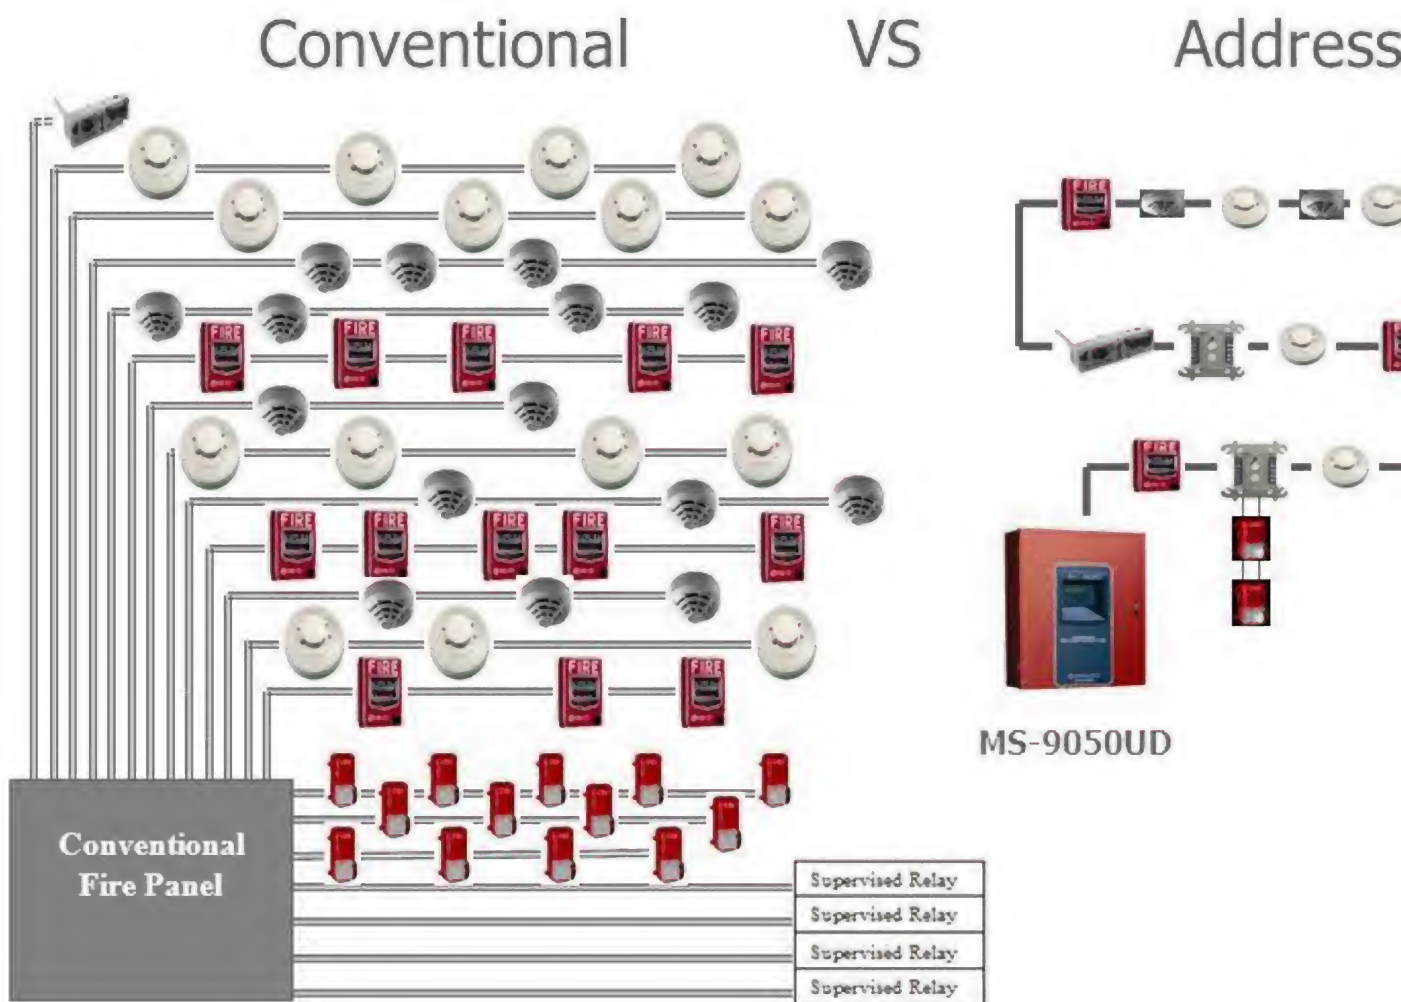

## FIRE ALARM SYMBOLS


 FIRE ALARM PULL STATION AT +48".


 FIRE ALARM STROBE - +80" AFF OR 6" BELOW CEILING, WHICHEVER IS LOWER.

 FIRE ALARM HORN/STROBE - +80" AFF OR 6" BELOW CEILING, WHICHEVER IS LOWER.


 FIRE ALARM SPRINKLER MONITOR


 FIRE ALARM ANNUNCIATOR PANEL

 FIRE ALARM HEAT DETECTOR.

 FIRE ALARM SMOKE DETECTOR.

 FIRE ALARM DUCT SMOKE DETECTOR.

 FIRE ALARM TAMPER SWITCH.

 FIRE ALARM FLOW SWITCH.

NOTE: ALL FIRE ALARM DEVICES SHALL MEET A.D.A. REQUIREMENTS.